

## ANALYSIS AND DESIGN OF TRANSMISSION TOWERS FOR DIFFERENT WIND VELOCITIES

K. N. Venkata Lakshmi<sup>1</sup>, T.Sujatha<sup>2</sup>, B. Panduranga Rao<sup>3</sup>

<sup>1</sup>P.G Student, <sup>2</sup>Asstt. Professor, <sup>3</sup>Professor & Dean of Student Affairs and Civil Consultancy  
Dept of Civil Engineering, V.R.Siddhartha Engineering College, Vijayawada, India.

### ABSTRACT

*The Transmission towers are constructed for transmitting the electricity from generation station to substations. It costs almost 25 to 40 percent of the total cost of the transmission line. Transmission tower is an integrated system of conductor, ground wire and support structure. The function of transmission tower is to support the conductor wires and ground wire at suitable distance. Economical design can be obtained by selecting optimum base width and low tower weight. The proposal work is the analysis and design of 220 kV double circuits steel transmission line towers for different wind velocities of 50 m/s, 60 m/s, 70 m/s .STAAD. Pro program is going to be used for analysis and design the members of 220kV double circuit tower of A type. The maximum sag and tension calculations of conductor and ground wire as per IS: 5613 (Part 3/Sec 1) 1989. Loads on transmission tower are to be calculated using code IS802 (Part 1/Sec 1):1995.foundation is done according to IS 4091-1979.*

**KEYWORDS:** transmission tower; sag; tension; foundation;

### I. INTRODUCTION

The components of Transmission line tower are transmission tower, conductor wire, insulator strings and earthwire.

#### 1.1 Transmission Tower

The Electrical energy is generated in hydro electrical, nuclear and thermal power plants which are located far away from the cities. So transmission of power from generators to the substations is done with the help of overhead power lines i.e. transmission towers.

The design of transmission tower is generally based on minimum weight of tower. Lattice type tower which consists of primary bracing, secondary bracing and cross arms. The structural design of towers is mainly governed by wind loads acting on tower and conductors and self weight and other loads due to line deviation, broken wire condition, erection and maintance. The tower is modeled as a pin jointed space truss. Steel angle sections of different grades are generally used for towers. Steel poles are also used for transmission line but they are confined to short distances.

Tower foundation generally costs 10 to 15 % of tower. With increase in transmission voltage and size of tower, the loads on tower also increase. The problem of design and construction of foundation becomes challenging these days due to encounter of different soil conditions.

#### 1.2 ASCR Conductor

A conductor is a material that allows the electric current to pass through its body when it is subjected to a potential difference. Aluminum provides conductivity while steel provides mechanical strength.

### 1.3 Earth wire

The earthwire is used for protection against lightning and high voltage surges. Depending upon the shielding angle we generally provide one or two earth wires.

**Table 1** Property of Conductor and Earth wire

Property	Conductor wire	Earth wire
Material of wire	ASCR MOOSE conductor	Galvanized steel
No of wires	2	1
Stranding/Wire diameter	54/3.53 mmAL+7/3.18mm Steel	7/3.15mm
Total sectional area(mm <sup>2</sup> )	597	54.55
Overall diameter(mm)	31.77	9.44
Approximate weight(KN/Km)	1998	428
Calculated D.C resistance at 20 °C (ohm/Km)	0.05595	3.375
Min.UTS	16269.1	571
Elasticity modulus (Kg/mm <sup>2</sup> )	6900	19361
Co – efficient of linear expansion(/°C)	19.3×10 <sup>-6</sup>	11.50 x 10 <sup>-6</sup>
Max allowable temperature(°C)	75	53°C

### 1.4 Insulator Strings:

Insulators are the materials that don't allow current to pass through them. They are devices which are use to support the conductors. They separate the conductors of a transmission line from their supporting steel structures and prevent the flow of current into the ground through the structure. They provide mechanical support to the conductors at a greater height above the ground level. 2×14 No. Disc of double insulator string of length 2640mm is chosen.

## II. DETAILS OF TOWER CONFIGURATION

**2.1 Type of tower:** Suspension tower

**2.2 Wind:** Wind speeds of 50 m/s, 55 m/s, 60 m/s respectively are taken.

**Table 2** Design wind speed

Tower	Design wind speed(m/s)	Design wind pressure(N/mm2)
Tower 1	50	925
Tower 2	55	1120
Tower 3	60	1332

The tower outline can be determined by:

- Tower height from ground level
- Tower width at the base and at top hamper
- Length of cross arm
- Spacing between the conductors

### 2.3 Tower Outline:

Height of tower =h1+h2+h3+h4

h1=Min permissible ground clearance = 7m

h2=Maximum sag calculated=7.5m

Sag calculations is done from IS 5613 (PART 2/SEC 1)-1985 for 220KV of MOOSE type of conductor and Earth wire.

**Table 3** Sag calculation for conductor wire

Temperature	12°	32°	75°	100°	55°
Wind (%)	0	0	75	100	0
Tension(kg)	4443	4352	5734	<b>6470</b>	4172
Sag(m)	6.886	7.028	5.33	4.728	<b>7.33</b>

Table 4 Sag calculation for Earth wire

Temperature	12°	32°			55°
Wind (%)	0	0	75	100	0
Tension(kg)	2358	1986	2350	<b>2547</b>	1606
Sag(m)	2.76	3.284	2.775	2.56	<b>4</b>

h3=spacing between conductors vertically = 5.2m  
 h4= clearance between earth wire and top conductor vertically  
 = 5.2 m  
 Width at the base : 5m  
 Width at the waist level: 3m  
 Width at the bottom cross-arm level: 2m

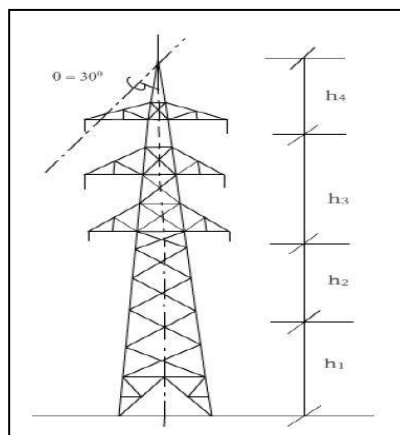


Fig. 1: Tower with dimensions marked

### III. LOADINGS ON TOWER

Loadings on tower are calculated as per IS802 1995 for:

- i. Reliability condition
- ii. Security condition
- iii. Safety condition

Reliability of a transmission system is the probability of that the system would perform its function under the designed load criteria for a specified period. Thus, it covers climatic loads such as wind loads and ice loads.

Security of a transmission system is the capacity of the system to protect itself from any major failure arising out of the failure of its components. Thus, this covers unbalanced longitudinal loads due to broken wires.

Safety of a transmission system is the ability of the system to provide protection against any injuries or loss of lives to human beings out of the failure of any of its components. Thus, it covers loads imposed on tower during the construction of transmission line and loads imposed on tower during the maintenance of transmission line.

The loads acting on tower are longitudinal, transverse and vertical loads.

Longitudinal loads due to tension in the conductor, transverse loads due to wind acting on tower and conductors, vertical loads due to self weight of tower and weight of conductor wires.

### IV. MODELLING

Modelling of 3 towers was done in STAAD Pro for different wind velocities.

Angle sections were used for the members.

The height and base width of each tower is made constant of 30.2m and 5 m.

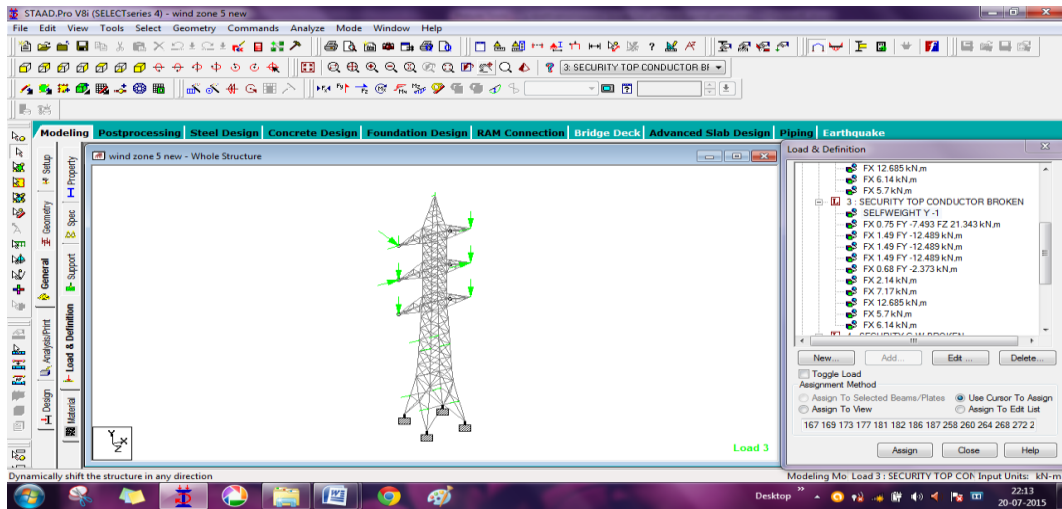


Fig. 2: Modelling of tower in STAAD Pro

## V. RESULTS

The tower was analyzed and designed using Staad Pro. Maximum deflections of the nodes and maximum axial forces in the members are the important parameters of this study and they are compared for 3 wind velocities. Foundation is done for clayey soil and hard rock conditions. The depth of pile foundation and depth of pile cap for is designing for clayey soil of bearing capacity of 80KN/m<sup>2</sup>.The rock anchor type foundation is designed for hard rock of bearing capacity of 1250 KN/m<sup>2</sup>.

Table 5 Maximum deflection

Tower	Max X(mm)	Max Y(mm)	Max Z(mm)
1	296.4	59	96
2	325.9	73	85
3	312.14	68.9	69.75

Table 6 Maximum forces in members

Tower	Axial force (KN)
1	423.9
2	552
3	643

Table 7 Weight of the Tower

Tower	Weight(KN)
1	46.64
2	47.543
3	52.323

Table 8 Support Reactions

Tower	X(KN)	Y(KN)	Z(KN)
1	60.24	377.5	127
2	70	495	154
3	81.06	577.1	179

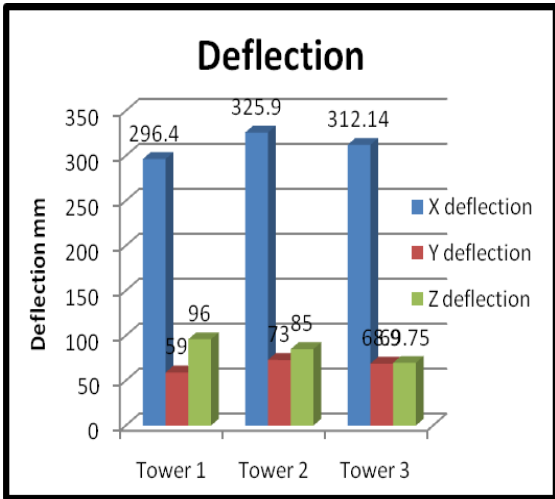


Fig 3 Maximum deflection of nodes

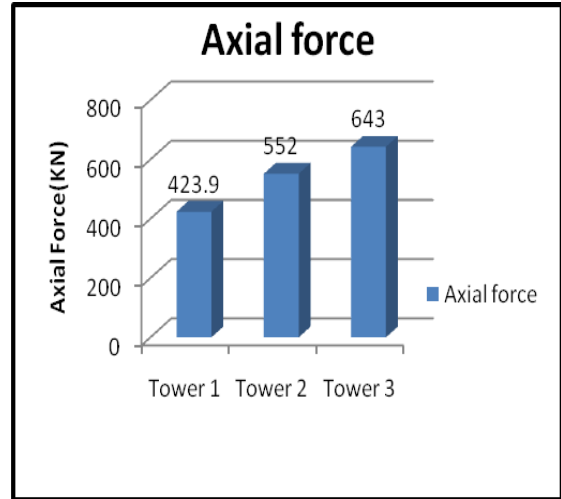


Fig 4 Maximum axial forces in members

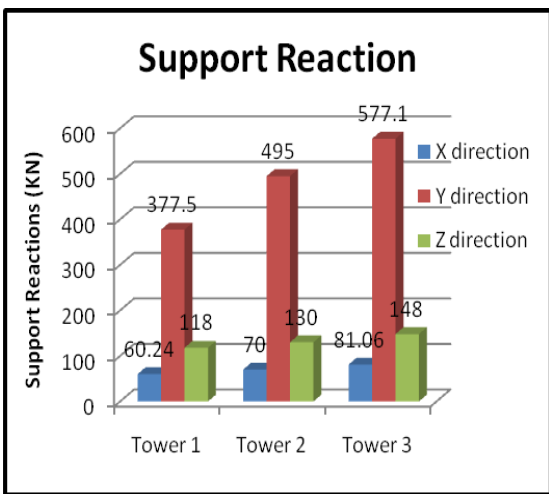


Fig 5 Support reactions

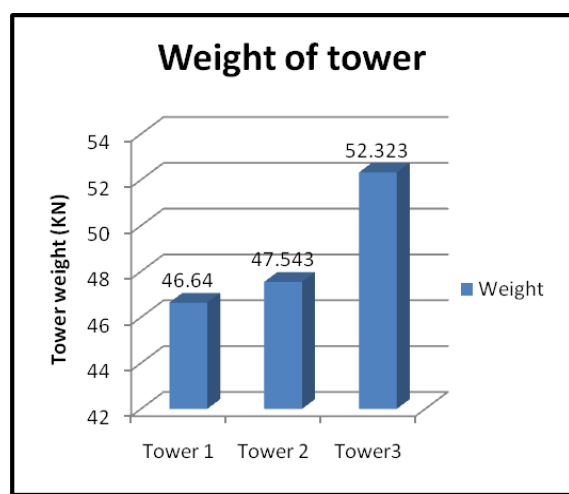


Fig 6 Weight of the tower

Table 9 Pile foundation

	Tower 1	Tower 2	Tower 3
Pile length(m)	14	16	18
Diameter of pile(mm)	500	500	500
Compression (KN)	120	134	149.4
Lateral load(KN)	36	40.1	44.8
Ast provided and Lateral reinforcement	5no 20mm # and 8 mm $\phi$ @ 160 c/c spacing	5 no25 mm# and 8 mm $\phi$ @ 160 c/c spacing	5 no 25 mm# and 8 mm $\phi$ @ 160 c/c spacing
Pile cap thickness(mm)	420	490	540
Reinforcement in pile cap	20 mm # @320mm c/c spacing	20 mm # @280mm c/c spacing	20 mm # @250mm c/c spacing

For rock anchor type foundation slab of size of 1.5 m×1.5m and depth of slab of 1000mm and with 4 anchor bars embedded in grouted anchor holes of 1.2 m depth for each footing is recommended for 3 towers.

## VI. CONCLUSIONS

The study shows that the

- The deflection of tower increases with increase in wind velocities.
- The weight of tower increases with increase in wind velocities and the for the 3<sup>rd</sup> tower there is more increment when compared to the other towers as double angles is provided at leg members due to high axial forces were developed in leg members.

- The maximum forces are obtained at middle panel for all the 3 towers.
- The depth of piles increased with increase in wind loads as the compressive loading and lateral forces increases.
- For Rock anchor type foundation the minimum depth of slab provided 1000mm is sufficient for all the 3 towers against uplift of foundation.

### **ACKNOWLEDGEMENTS**

I would like to thank my project guide, my friends, Head of the Department civil engineering for their guidance and support.

### **REFERENCES**

- [1]. V. Lakshmi, M.V.R. Satyanarayana, V. Ravindra “Study on performance of 220 Kv tower due to wind” International journal of engineering science and technology ISSN: 0975-5462 Vol. 3 No. 3 March 2011 PP 2474-2485
- [2]. Dharmender panth “Reasons for failure of transmission lines and their prevention strategies” International journal of electrical, electronics and data communication. ISSN: 2320-2084 volume-2, issue-1, jan.-2014
- [3]. N. Prasad rao, G.M. Samuel knight, N. Lakshmanan, Nagesh R. Iyer “Investigation of transmission line tower failures” Journal of engineering failure analysis volume 17 (2010) pp 1127–1141
- [4]. V. Lakshmi, A. Rajagopal Rao “Effect of Medium Wind Intensity on 21 meters height 132kv Transmission Tower” International journal of engineering science & advanced technology, volume-2, issue-4, pp 820 – 824
- [5]. Ch. Sudeer, K. Rajasekhar, P. Padhamanabha Reddy, Y. Bhargava Gopi Krishna “Analysis and Design of 220kv Transmission Line Tower in Different Base Widths-A Comparative Study.” International journal of technology enhancements and emerging engineering research ISSN 2347-4289 vol 1, issue 4 pp 35-43
- [6]. Yoganantham. C, Helen Santhi. M “Dynamic Analysis of Transmission Towers” International Journal of Advanced Information Science and Technology (IJAIST) ISSN: 2319:2682 Vol.20, No.20, December 2013 PP98-101
- [7]. “Code of practice for Use of Structural Steel in Over Head Transmission Line Towers - Permissible stresses.” (1992). IS: 802 (Part 1 / Sec 2)
- [8]. “Code of practice for Use of Structural Steel in Over Head Transmission Line Towers- Testing.” (1978). IS: 802, (Part III)
- [9]. Miranda Kullolli, Genci Sharko and Rejnald Zyfib. “Design Against the Vulnerability of Overhead Transmission Line Caused by Galloping”, International Journal of Advances in Engineering & Technology (IJAET), Volume 7 Issue 4, pp. 1131-1140, Sept. 2014.
- [10]. Transmission Line Manual: No. 268, C.B.I.P
- [11]. “Transmission Line Structures” by S. S. Murthy and A. R. Santhakumar.

### **BIOGRAPHY**

**K. N. Venkata Lakshmi**- She received B.Tech Degree from Bapatla Engineering College. Presently she is pursuing M.Tech in V.R. Siddhartha Engineering College, Vijayawada.



**T. Sujatha** –She presently working as Asst Professor in V.R.Siddhartha Engineering College, Vijayawada, She Completed her B.Tech and M.Tech her V.R.Siddhartha Engineering College, Vijayawada, and teaching experience of 7 years.



**B. Panduranga Rao** he presently working as Professor and Dean of student affairs and civil consultancy work in V.R.Siddhartha Engineering College, Vijayawada with teaching experience of 30 years .

